





PRESJEK SPREMNIKA

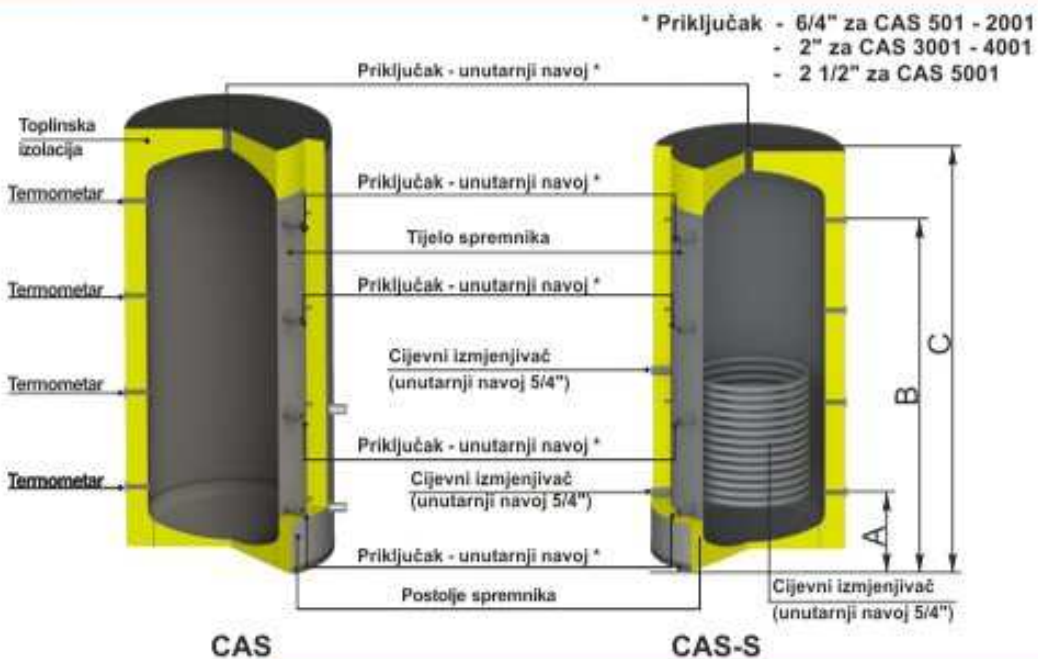


CAS



CAS-S



CAS-B



Tip	CAS-S								CAS-S			CAS-BS			CAS-B		
	501	801	1001	1501	2001	3001	4001	5001	501	801	1001	501	801	1001	501	801	1001
Volumen (lit.)	475	740	940	1450	2160	2960	3820	5055	475	740	940	475	740	940	475	740	940
Promjer tijela sprem. D (mm)	650	790	790	1000	1200	1250	1400	1600	650	790	790	650	790	790	650	790	790
Vanjski promjer E (mm)	850	990	990	1200	1400	1450	1600	1800	850	990	990	850	990	990	850	990	990
Ukupna visina C (mm)	1670	1750	2150	2100	2180	2695	2790	2875	1670	1750	2150	1670	1750	2150	1670	1750	2150
Priklučci (R)	6/4"	6/4"	6/4"	6/4"	6/4"	2"	2"	2 1/2"	6/4"	6/4"	6/4"	6/4"	6/4"	6/4"	6/4"	6/4"	6/4"
Max. radni tlak (bar)	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3
Max. radna temp. (°C)	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Min. visina prostorije (mm)	1870	1950	2350	2300	2335	2915	3015	3005	1870	1950	2350	1870	1950	2350	1870	1950	2350
Masa tijela spremnika (kg)	75	99	149	185	245	-	-	-	100	135	185	120	175	225	105	135	176
Ukupna masa spremnika (kg)	84	112	164	204	265	-	-	-	109	150	201	129	190	241	114	150	191
Volumen sprem. PTV (lit.)	-	-	-	-	-	-	-	-	-	-	-	125	170	170	125	170	170
Max. radni tlak spr. PTV (bar)	-	-	-	-	-	-	-	-	-	-	-	6	6	6	6	6	6
Priklučci PTV (R)	-	-	-	-	-	-	-	-	-	-	-	3/4"	3/4"	3/4"	3/4"	3/4"	3/4"
Ogrj. površina spirale (m²)	-	-	-	-	-	-	-	-	1,9	2,6	3,2	1,9	2,6	3,2	-	-	-
Volumen ogrj. spirale (lit.)	-	-	-	-	-	-	-	-	10,5	14	17,5	10,5	14	17,5	-	-	-
Toplinska izolacija (mm)	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Visina A (mm)	230	320	320	320	355	370	420	515	230	320	320	230	320	320	230	320	320
Visina B (mm)	1380	1370	1770	1720	1755	2260	2310	2365	1380	1370	1770	1380	1370	1770	1380	1370	1770