


preporučene
min.-max. dimenzije
prostorije:

AxB = 1,5 x 2,5 m
4 x 8 m

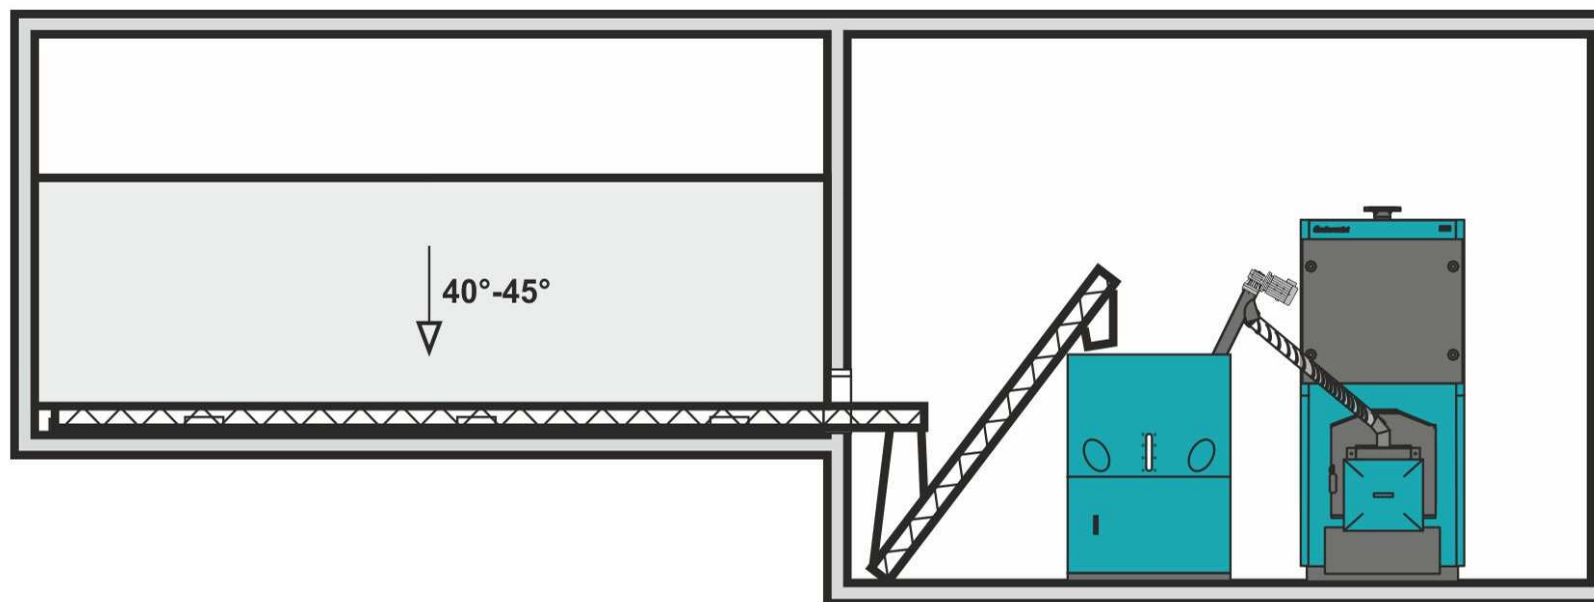

Primjer: dopunjavanje kotla
EKO-CKS P Unit (140 - 560
kW), dobavom iz prostorije
u međuspremnik CPSP-800

Mogućnost ugradnje
kaskade 2 kotla na jedan
međuspremnik CPSP-800.